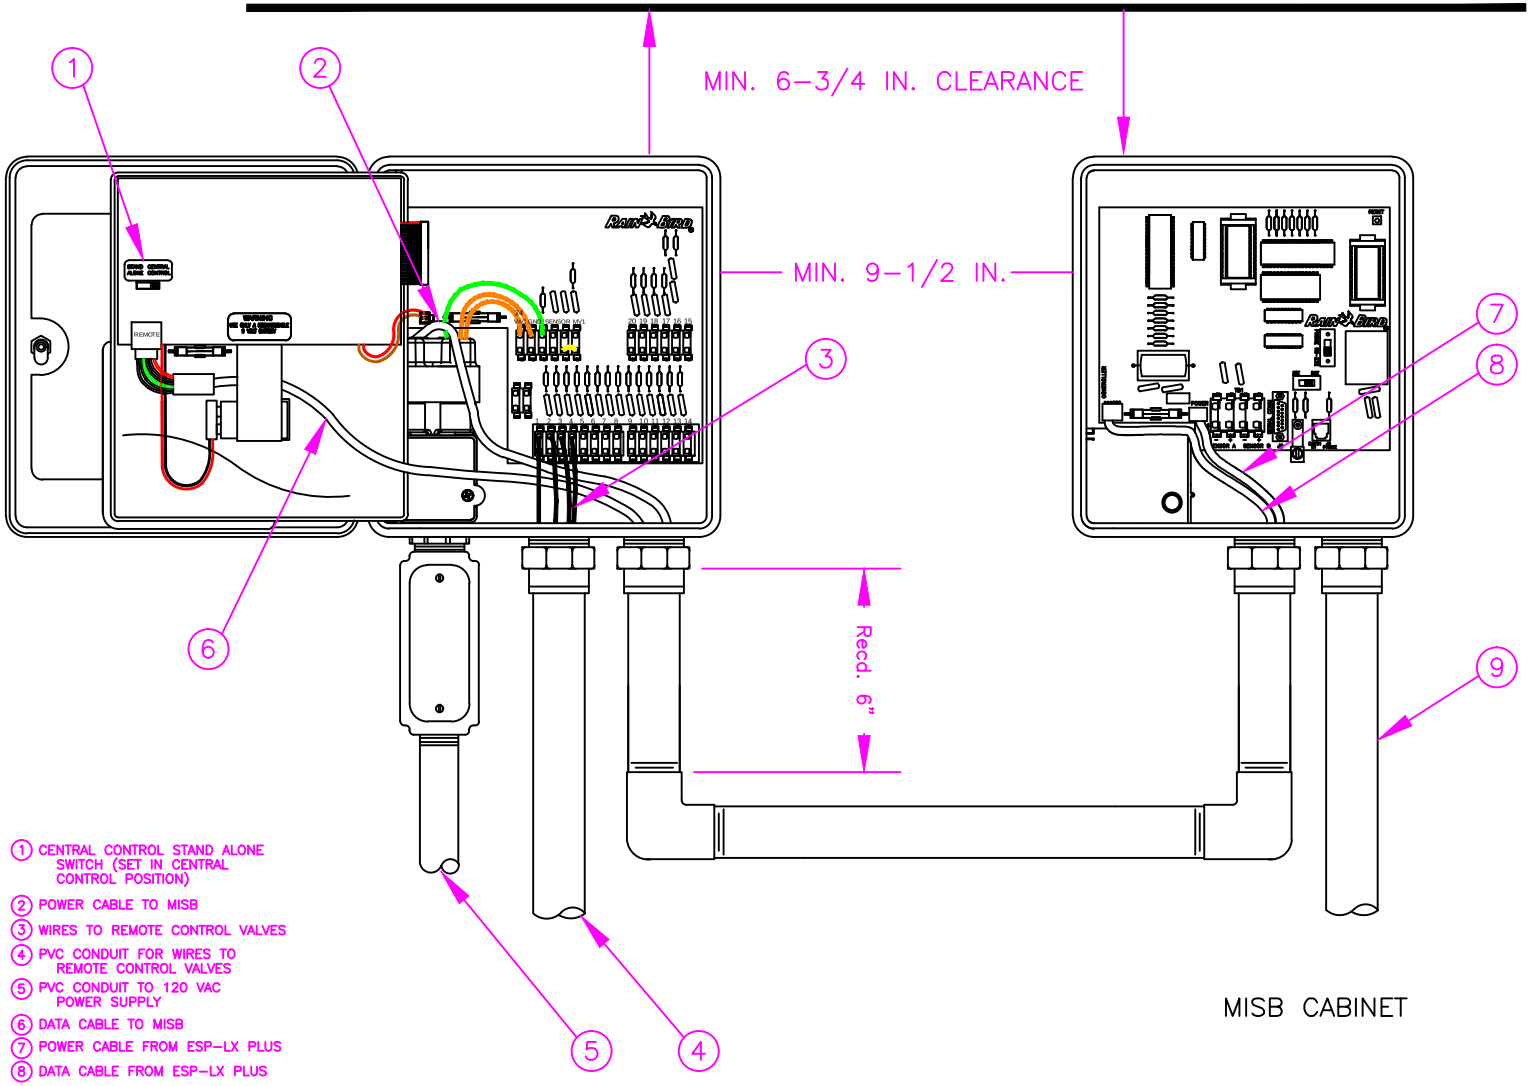

1. CENTRAL CONTROL STAND ALONE SWITCH (SET IN CENTRAL CONTROL POSITION)
2. POWER CABLE TO MISB
3. WIRES TO REMOTE CONTROL VALVES
4. PVC CONDUIT FOR WIRES TO REMOTE CONTROL VALVES
5. PVC CONDUIT TO 120 VAC POWER SUPPLY
6. DATA CABLE TO MISB
7. POWER CABLE FROM ESP-LX PLUS
8. DATA CABLE FROM ESP-LX PLUS
9. PVC CONDUIT FOR PHONE CABLE OR SENSOR WIRES

NOTE:
SEE MANUFACTURER'S INSTALLATION GUIDE FOR GROUNDING INSTRUCTIONS.

IRRIGATION TIMER MODULE INSTALLATION

EPHRATA PUBLIC WORKS DEPARTMENT

DATE	REVISION	BY

DRAWN
CHECK
SCALE NTS
DATE 01/10/11

CITY OF EPHRATA
GRANT COUNTY WASHINGTON

I-8